

InMax - Revolution

Electrical, industrial rotary actuators - size S

3-pos, 0...10 VDC, 4...20 mA, 24..230 VAC/DC, 95° Angle of rotation incl. 5° pretention
5/10 Nm - 15/30 Nm without and 5/10 Nm - 15 Nm with safety operation (spring return)

InMax- 5.10 - Y
InMax-15.30 - Y
InMax- 5.10 - YF
InMax- 15 - YF
InMax- ... - VA
InMax- ... - CT

Subject to change

Compact - Easy installation - Universal - Cost effective - Safe

Type	Torque	Supply	Motor running time	Spring return	Control mode	Feedback	Wiring diagram
InMax -5.10 - Y	5 Nm & 10 Nm	24..230VAC/DC	7,5/15/30/60/120 sec. at 90°	without	3-pos, 0...10VDC, 4...20 mA	0...10VDC, 4...20 mA	SB 4.0
InMax-15.30 - Y	15 Nm & 30 Nm	24..230VAC/DC	7,5/15/30/60/120 sec. at 90°	without	3-pos, 0...10VDC, 4...20 mA	0...10VDC, 4...20 mA	SB 4.0
InMax- 5.10 - YF	5 Nm & 10 Nm	24..230VAC/DC	7,5/15/30/60/120 sec. at 90°	3 or 10 sec. at 90°	3-pos, 0...10VDC, 4...20 mA	0...10VDC, 4...20 mA	SB 5.0
InMax- 15 - YF	15 Nm	24..230VAC/DC	7,5/15/30/60/120 sec. at 90°	3 or 10 sec. at 90°	3-pos, 0...10VDC, 4...20 mA	0...10VDC, 4...20 mA	SB 5.0
InMax- ... - VA	Type as above but with stainless steel housing (AISI 316) for aggressive ambient (12x12 shaft, shaft manual override, cable glands and hollow rivet nickel-plated)						
InMax- ... - CT	Type as above but with Al housing and amercoat painting (12x12 shaft connenction, shaft manual override, cable glands and hollow rivet nickel-plated)						

Application


Damper



Ball valve



Throttle valve



Description size S

The new InMax actuators are a revolution for safety, control and shut-off dampers, VAV systems, ball valves, throttle valves and other motorized applications for HVAC systems, in chemical, pharmaceutical, industrial and Offshore-/Onshore plants, for use in safe areas.

IP 66 protection, small dimensions, only 3,5 kg weight, universal functions and technical data, an integrated heater and an optional stainless steel housing guarantee safe operation even under difficult environmental conditions. High quality brushless motors guarantee long life. All actuators are programmable and adjustable on site. Special tools or equipment are not required. 5 motor running times and 2 torques as well as 2 spring return times - according to the actuator type - are selectable or adjustable on site. The integrated universal power supply is self adaptable to input voltages in the range of 24 to 230 VAC / DC. The actuators are 100% overload protected.

InMax-...-F actuators are equipped with spring return fail safe function. Standard shaft connection is a squared direct coupling with 12 x 12 mm.

Different accessories are available to adapt aux. switches, terminal boxes or adaptations for ball valves and throttle valves.

Highlights

- ▶ Industrial actuators
- ▶ Universal supply unit from 24 to 230 V - AC/DC
- ▶ 5 different motor running times (7,5-15-30-60-120 sec./90°), adjustable on site
- ▶ 2 different spring return running times (3-10 sec./90°), selectable on site
- ▶ 3-pos, 0...10 VDC, 4...20 mA control mode, with or without spring return function
- ▶ Feedback signal 0...10 VDC and 4...20 mA
- ▶ Reverse function
- ▶ 100 % overload protected, self locking
- ▶ Compact design and small dimension (l x w x h = 210 x 95 x 80 mm)
- ▶ Direct coupling to the damper shaft with squared connection 12 x 12 mm
- ▶ 95° Angle of rotation incl. 5° pre-tention
- ▶ Robust aluminium housing (optional stainless steel) with IP 66 protection
- ▶ Simple manual override include + preparation for comfortable manual override
- ▶ Gear made of stainless steel and sinter metal
- ▶ Only ~ 3,5 Kg weight
- ▶ Integral heater for ambient temperatures down to -40°C
- ▶ Integral safety temperature sensor
- ▶ Integral equipment for manual adjustment (push button, lamp, switch)
- ▶ Preparation for adaptable aux. switches type InSwitch
- ▶ Range of accessories

Technical data	InMax-5.10-Y	InMax-15.30-Y	InMax-5.10-YF	InMax-15-YF
Torque motor	5 / 10 Nm selectable on site	15 / 30 Nm	5 / 10 Nm	15 Nm
Torque spring return (F)	without F	without F	min. 10 Nm	min. 15 Nm
Dimension of external torque	above mentioned torques are min. torques in blocked position, external torque should be max. 80 % of max. actuator torque but min. 3 Nm			
Supply voltage/Frequency	24...230 VAC/DC, + 15 % / - 20% , self adaptable, Frequency 50...60 Hz +/- 20 %			
Dimension	max. starting currents see table (in acc. with voltage, I _{start} >> I _{rated}), max. 20 W blocking position, approx. 16 W for heater			
Protection class	class I (grounded)			
Angle of rotation and indication	95°, incl. ~ 5° pre-tention, mechanical value indication			
Working direction	selectable by left/right mounting to the damper/valve shaft			
Motor running time	7,5 / 15 / 30 / 60 / 120 sec. at 90° selectable on site			
Motor	brushless DC Motor			
Spring return (F)	without F	without F	spring return in the event of loss of power	
Spring return running time (F)	without F	without F	spring return in 3 sec., or 10 sec. at 90°, selectable on site	
3 sec. mode - spring return	without F	without F	in acc. with external torque 3 to 4 sec. at 90° angle of rotation	
Safety operations at 10 sec (F)	without F	without F	min. 10.000 in acc. with construction of damper and ambient	
Safety operations at 3 sec (F)	without F	without F	min. 1.000 in acc. with construction of damper and ambient	
Response time spring return	up to 1 sec. after power failure			
Control mode Y	3-pos, 0..10 VDC, 4...20 mA in acc. with wiring, selectable on site, galvanic separation between supply and signals			
Feedback signal U	0..10 VDC, 4...20 mA in acc. with wiring, selectable on site			
Resistance of Y and U signals	Input signal Yu 0...10 VDC @ 10 kΩ, Yi 4...20 mA @ 100 Ω. Feedback signal Uu 0...10 VDC @ 1.000...∞ Ω, Ui 4...20 mA @ 0..800 Ω			
Reverse function	Bridge between wiring 3 and 4 (signal wise) gets a reverse function of Y and U			
Adjustment of Y and U	If the angle of rotation is different to 90° the input Y and output signal U can be adjusted to the new angle of rotation			
Axle of the actuator	double squared 12 x 12 mm, direct coupling, 100 % overload protected and 100 % self locking up to 15 Nm			
Electrical connection	cable, ~1 m, diameter of wires 0,5 mm²			
Diameter of cable	~ Ø 7,1 mm and ~ Ø 7,4 mm	~ Ø 7,1 mm and ~ Ø 7,4 mm	~ Ø 7,1 mm and ~ Ø 7,4 mm	~ Ø 7,4 mm and ~ Ø 7,4 mm
Cable gland	M16 x 1,5 standard			
Manual override	Manual override only if supply voltage is cut, use delivered socket wrench, slow motion, enough torque/force is required Attention: with manual operation of actuators with spring return danger of injury exists, with release/let go the socket wrench.			
Integral heater	integral heater, controlled, for ambient temperature down to - 40°C			
Housing material and weight	Aluminium die cast housing, painted (optional in stainless steel version, Type InMax-.../VA)			
Dimensions	l x w x h 210 x 95 x 80 mm, for diagramm see extra information "ME"			
Weight	~ 3,5 Kg Aluminium housing (stainless steel ~ 7 Kg)			
Ambients	storage temp. - 40..+ 70°C, working temperature - 40..+ 50°C, humidity in acc. with EN 60335-1			
Operation mode	15/30/60/120 Sek 100 % ED 7,5 Sek at 24 VAC and load >= 15 Nm S3 50% ED			
Self adjustment	at initial system checkout for motor you need to start the self adjustment mode.			
Maintenance	maintenance free, maintenance must be complied with regional standards, rules and regulations			
Wiring diagrams (SB)	SB 4.0	SB 4.0	SB 5.0	SB 5.0
Delivery	1 actuator, 1 m cable, squared shaft connection 12x12 mm, 4 x M4x100 mm screws , 4 nuts M4 socket wrench for simple manual override			
Parameter at delivery	5 Nm, 30 sec./90°	15 Nm, 30 sec./90°	5 Nm, 30 sec./90°	15 Nm, 30 sec./90°

Certification	InMax actuators - size S
EMV	EMV-RL 89/336/EG
Low voltage	Low-voltage RL 73/23/EG
IP-Protection	IP 66, in acc. with EN 60529
Potential compensation	external PA-terminal, 4 mm²

Accessories or special solutions - size S
InMax-...-VA above listed types in stainless steel version, housing AISI 316.
InMax-...-CT above listed types in Al-housing with amercoat painting, parts nickel-plated
InBox-...-Y/S terminal box
MKK-S mounting bracket for terminal boxes type InBox-... direct on actuator
InSwitch 2 external aux. switches, adjustable on site
KB-S clutch for damper shafts Ø 10...20 mm and 10...16 mm.
HV-S comfortable manual override for InMax actuators size S
Adaptations various adaptations for dampers/valves on request
AR-12-xx Reduction of square damper connection from 12 mm to 11, 10, 9, 8


Electrical connection

InMax actuators are equipped with a universal supply unit working at a voltage range from 24 to 230 VAC/DC. The supply unit is self adjustable to the connected voltage! The safety operation of the spring return function works if the supply voltage is cut.

Parameter, Adjustment - Failure indication

Switch - Push button - Lamp for adjustment, behind the blanking plug

- 10-position switch (S)
- Push button (T)
- 3-colour LED

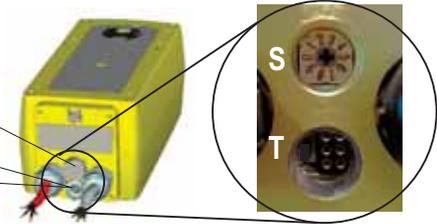

Wiring diagram InMax-5.10-Y and InMax-15.30-Y

Continuous control or 3-pos without spring return SB 4.0

Self adjustment:
To adjust the signal input/output to the Angle of rotation of the damper/valve the button T must be pushed for minimum 3 sec.

24...230 VAC/DC

Function of switch a and b:
 - a closed, On (Off) - in acc. to left/right mounting of the actuator
 - b closed, Off (On) - in acc. to left/right mounting of the actuator

Parameter selection

Example: InMax-15.30-Y
 Requested parameter:
 Torque 30 Nm
 Running time motor 30 sec/90°

Type	Torques	
InMax- 5.10 -Y	5 Nm	10 Nm
InMax- 15.30 -Y	15 Nm	30 Nm
InMax- 5.10 -YF	5 Nm	10 Nm
InMax- 15 -YF	15 Nm	

Running times	Position of switch S	
7,5 sec./90°	00	05
15 sec./90°	01	06
30 sec./90°	02	07
60 sec./90°	03	08
120 sec./90°	04	09

Result: switch position (S) 07

Wiring diagram InMax-5.10-YF and InMax-15-YF

Continuous control or 3-pos with spring return SB 5.0

Self adjustment:
To adjust the signal input/output to the Angle of rotation of the damper/valve the button T must be pushed for minimum 3 sec.

24...230 VAC/DC

Function of switch a and b:
 - a closed, On (Off) - in acc. to left/right mounting of the actuator
 - b closed, Off (On) - in acc. to left/right mounting of the actuator

Selection of running time for spring return:
 Standard wiring = spring return in ~10 Sek
 Additional wiring terminal 5 = spring return in ~ 3 Sek

Function, adjustment and parameter

- A) Self adjustment of Angle of rotation:**
 Switch (S) into position 02 (low torque) or 07 (high torque), then push button (T) for minimum 3 seconds. The actuator will drive into both end positions to be adjusted. LED indicates green.
 Adjustment time needs approx. 60 sec. (30 sec. On, 30 sec. Off). After that, switch S into position 00-09 in acc. with your required torque and running time.
- B) Selection of running time and torque:**
 Put switch (S) into the correct/selected position in acc. to above table. The selected parameter will work at next operation of the actuator. Adjustment can be done even without supply voltage. If supply voltage is available turn switch only if actuator is not running.
- C) Running time spring return:**
 The running time of 3 or 10 sec. spring return is selected by wiring. (see wiring diagrams SB 5.0)
- D) Change from modulating into 3-pos operation mode:**
 Push button (T) 3 times. LED changes from green to yellow.
 Push button within next limits:
 - Push time min. 0,2 sec.
 - The max. time for 3 push is 5 sec.
- E) Change from modulating into 3-pos operation mode:**
 Push button (T) 3 times. LED changes from yellow to green.
- F) Additional information for 3-pos operation:**
 a closed, b open = direction I
 b closed, a open = direction II
 a and b closed = Motor doesn't work
 a and b opened = Motor doesn't work
 Direction (I and II) depends on left/right mounting of the actuator to the damper/valve. You can change direction of the motor by changing electrical wiring terminal 3 and 4.
- G) Reverse function:**
 Bridge between wiring 3 and 4 (signal wise) gets a reverse function of Y and U.

Modulating- 3 pos- change

LED	Status
GREEN	Supply available, Actuator active in modulating mode
YELLOW	Supply available, Actuator active in 3-pos mode

Error indication

See extra information "EL"

Attention!

Never use actuators in spring return mode without external torque/force.

Mounting instructions and important information for operation and installation

Important information for installation and operation

A. Installation, commissioning, maintenance

The cable of the actuator must be installed in a fixed position and protected against mechanical and thermal damage. In acc. with operation InMax actuators are maintenance free.

The actuators must not be opened by the customer. For outdoor installation a protective housing against rain, snow and sun should be applied to the actuator, as well as a constant supply at terminal 1 and 2 for the integral heater.

B. Shaft connection, selection of running time, heater

InMax actuators are equipped with a direct coupling squared shaft connection of 12 x 12 mm. The housing of the actuator is axially symmetrically built to select open/close direction of the spring return function by left/right mounting. In acc. to the actuator type 5 different motor running times can be selected on site. The integral heater is for ambient temperatures down to -40°C.

C. Minimum load

Minimum load not less than 20% of the rated torque, min. 3 Nm

D. 3-pos control mode

See extra information "EL".

E. Spring return

Spring return function works if the supply voltage (terminal 1 or 2) is cut. In the event of an electrical interruption, the spring returns to its end position.

F. Operation at an ambient temperature below - 20°C

See extra information "EL".

G. Excess temperature

InMax actuators are equipped with an additional temperature sensor to stop the actuator before reaching this max. temperature. In this case the failure must be eliminated immediately on site.

Extra information "EL" (see additional data sheet)

extra technical information, versions of circuit diagrams and failure indication

Extra information "ME" (see additional data sheet)

extra technical information, dimensions, installation instruction and illustration

Mounting on air dampers with double squared shaft connection

Details see extra information "ME".



Mounting on air dampers with clutch

Details see extra information "ME".



Mounting of quarter turn valves

Details see extra information "ME".



InSwitch - adaptable external aux. switches

InSwitch is an accessory to InMax actuators size S, fixing directly onto the actuator. InSwitch are aux. switches with with 2 potential free contacts, adjustable on site.



InBox - adaptable terminal box

For electrical connection of an InMax actuator.
InBox-3P for InMax-5.10, ..-15.30, ..-5.10-F, ..-15-F
InBox-Y/S for InMax-...-S integral aux. switches
 To adapt the ExBox direct to the actuator housing an additional accessory **type MKK-S** is required.



InMax - extra information EL



The "EL"-data sheet contains additional information for InMax actuators of the size "S", for the optimization and simplification in regard to planning, installation and initial startup. It provides influences of external factors in reference to the safe initiation of the actuators, as well as technical references and problem solutions (error indication). With the error indication, functions can be examined and different error/problems can be adjusted locally.

- ▶ Power supply design
- ▶ Design of line cross section 24...48 VAC/DC
- ▶ Wiring alternatives for on-off, 3-pos, BF actuators
- ▶ Wiring alternatives for modulating actuators
- ▶ Use at ambient temperatures down to -20°C / - 40°C ()
- ▶ Error indication - problem treatment/solution

For additional mechanical data have a look at "extra information ME"

Power input depending of supply voltage

Power supply design

The design of the on-site supply, depends on the selected motor running time and selected supply voltage. Accompanying values are "about values", since there can be construction unit dispersions within electronics. The power consumption in the blocking position is run time independently with max. 20 W. The power consumption for the heater is approx. 16W. The heading is running only if the engine is in idle position! The initial starting supply voltage required by the actuators power supply unit is around 2,0 A for about 1 Sec. (Please consider this while conceiving the cross section of the supply line)

Voltage	Current	Rated current in acc. with motor running time				
		3/7,5s	15s	30s	60s	120s
230 V	I _{rated}	0,5 A	0,3 A	0,15 A	0,10 A	0,10 A
120 V	I _{rated}	0,75 A	0,4 A	0,3 A	0,25 A	0,25 A
48 V	I _{rated}	2,0 A	0,5 A	0,3 A	0,2 A	0,2 A
24 V	I _{rated}	4,7 A	1,45 A	0,52 A	0,4 A	0,4 A

Dimensioning of the line cross section with 24 ...48 VAC/DC supply voltages

Dimensioning/Design of the supply line

On long distances between voltage supply and drive, voltage drops occur due to line resistances. As a consequence with 24 VAC/DC the actuator receives a too low tension and does not start. In order to prevent this, the cross section of the inlet line is to be designed/dimensioned accordingly. The accompanying formula allows the calculation of the necessary line cross section, perhaps provides the maximally permitted conduit length utilizing the existing line cross section. Alternatively the secondary voltage can be increased by selecting a transformer. For calculation purposes, following characteristics are essential:
 UV = supply voltage in [V]
 A = line cross section in [mm²]
 L = conduit length in [m]
 Factor 0.0714 = drive-specific factor
 [Vmm²/m] (based on the electrical conductivity of electrolytic copper with a coefficient of 56m/Wmm²)

Formula for max. cable length "L" at cable cross section "A"


$$L = A \cdot (U_v - 18V) : 0,0714$$

Example: A = 1,5 mm², U_v = 24 V
Length of cable L = 126 m

Formula of needed cable cross section "A" at a cable length of "L"

$$A = 0,0714 \cdot L : (U_v - 18V)$$



Example: L = 250 m, U_v = 30 V
Cross section of A = 1,5 mm²

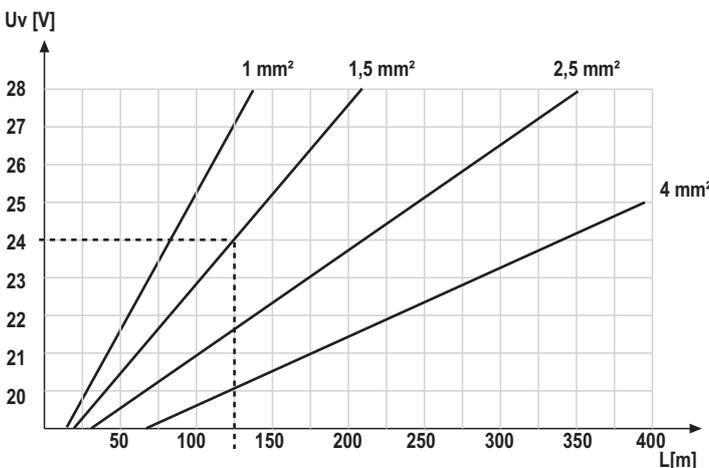

Example:
 24 V power supply with wire diameter 1,5 mm² = 126 m

Wiring alternatives for on-off and 3-pos actuators with spring return

InMax-...-F, InMax-...-SF

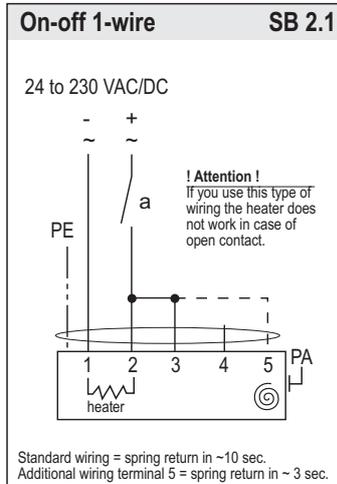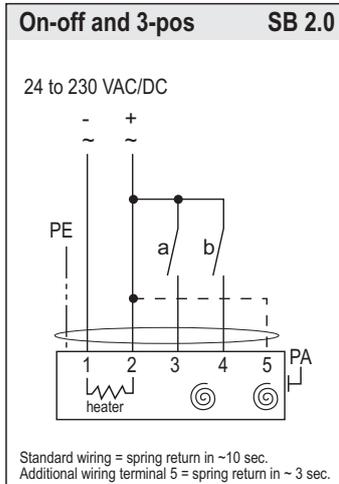

! Attention! !




If 3 sec. mode is selected, the self adjustment of angel of rotation must be started and operation mode of max. 10% ED must be guaranteed.
Never operate actuator in the 3 sec mode without an outside load of min. 3 Nm.

Engaging 1 wire On/Off controls in the 3 sec. modus with spring return is not possible. The actuator can only be operated with 1 On/Off function per minute otherwise electronics will be liable to overheating.

See additional note 3 sec. motor running time

Wiring alternatives for BF actuators

InMax-...-BF

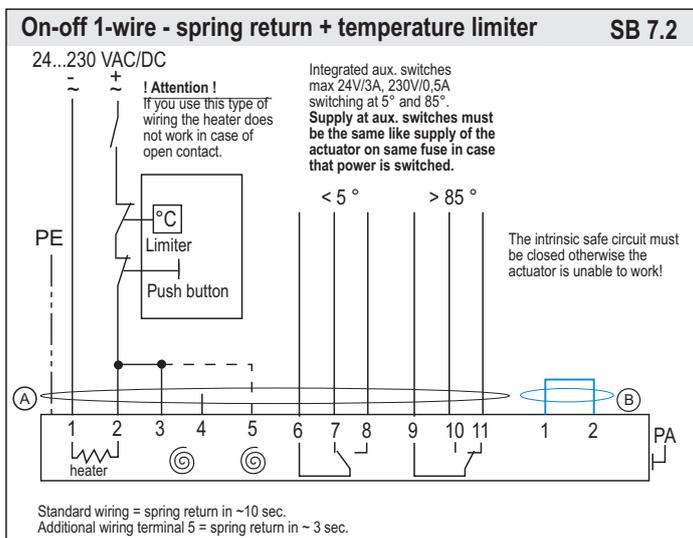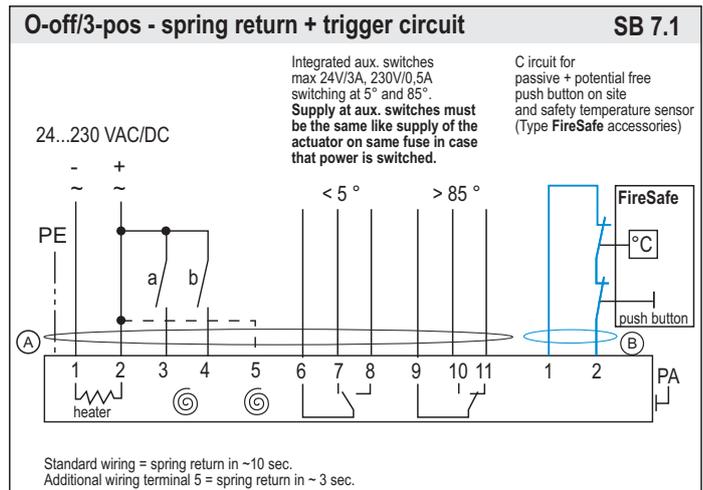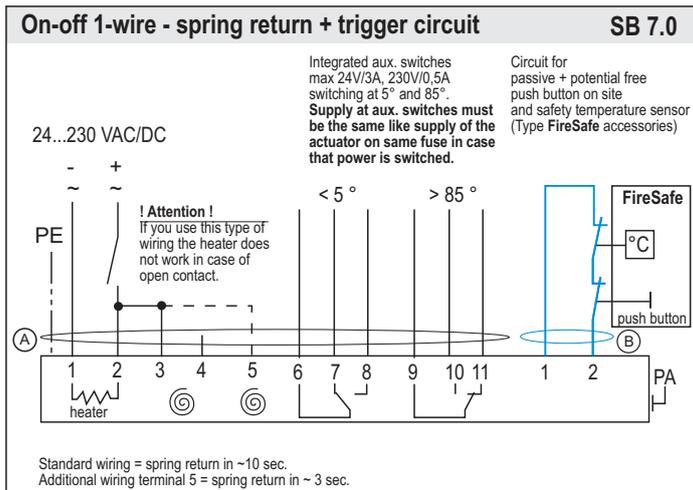

! Attention! !

If 3 sec. mode is selected, the self adjustment of angel of rotation must be started and operation mode of max. 10% ED must be guaranteed.
Never operate actuator in the 3 sec mode without an outside load of min. 3 Nm.

Engaging 1 wire On/Off controls in the 3 sec. modus with spring return is not possible. The actuator can only be operated with 1 On/Off function per minute otherwise electronics will be liable to overheating.

See additional note 3 sec. motor running time

Wiring alternatives for modulating actuators with or without spring return

InMax...-Y..

Modulating or 3-pos with/without spring return SB 5.0

24...230 VAC/DC

Self adjustment:
To adjust the signal input/output to the Angle of rotation of the damper/valve the button T must be pushed for minimum 3 sec.

Selection of running time for spring return:
Standard wiring = spring return in ~10 Sek
Additional wiring terminal 5 = spring return in ~ 3 Sek

Reverse function: ①
bridge 3-4 reverse input and output signals.

Function of switch a and b:
- a closed, On (Off) - in acc. to left/right mounting of the actuator
- b closed, Off (On) - in acc. to left/right mounting of the actuator

Modulating with/without spring return SB 5.1

24...230 VAC/DC

Self adjustment:
To adjust the signal input/output to the Angle of rotation of the damper/valve the button T must be pushed for minimum 3 sec.

Selection of running time for spring return:
Standard wiring = spring return in ~10 Sek
Additional wiring terminal 5 = spring return in ~ 3 Sek

Reverse function: ①
bridge 3-4 reverse input and output signals.

Modulating with/without spring return, no feedback SB 5.2

24...230 VAC/DC

Self adjustment:
To adjust the signal input/output to the Angle of rotation of the damper/valve the button T must be pushed for minimum 3 sec.

Selection of running time for spring return:
Standard wiring = spring return in ~10 Sek
Additional wiring terminal 5 = spring return in ~ 3 Sek

Reverse function: ①
bridge 3-4 reverse input and output signals.

3-pos with/without spring return, plus feedback SB 5.3

24...230 VAC/DC

Self adjustment:
To adjust the signal input/output to the Angle of rotation of the damper/valve the button T must be pushed for minimum 3 sec.

Selection of running time for spring return:
Standard wiring = spring return in ~10 Sek
Additional wiring terminal 5 = spring return in ~ 3 Sek

Reverse function: ①
bridge 3-4 reverse input and output signals.

Function of switch a and b:
- a closed, On (Off) - in acc. to left/right mounting of the actuator
- b closed, Off (On) - in acc. to left/right mounting of the actuator

3-sec. mode, 3-pos-operation, heating by low ambient temperatures

I. Operation with 3 sec. motor running time mode

Note following at 3 sec. motor running time:

1. The 3 sec. motor running time mode is only in switch position 0 and 5 and at a constant supply voltage on terminals 1 and 2 which must be in minimum for 1 minute applied available.
2. The actuator opens at voltage on terminal 3 (resp. closes), and closes at voltage on terminal 4 (resp. opens) depending on mounting position of the actuator.
3. The max. duty ratio is 10 % resp. 1 cycle / minute. Between two fully cycles to the same direction there must be a minimum intermission of 1 minute. The actuator is blocked if the break time is less than 1 minute. The release for the next cycle is made automatically by an internal timing relay.
4. Same function is applied on spring return actuators. Failure safe operation is regarded same as a motor running cycle.
5. If its tried to use the 1 wire On/Off methode in switch position 0 and 5, software changes the running time temporarily and automatically to 15 sec. motor running time to protect the actuator for overheating due to uncontrolled duty ratio.
6. The actuator must be operated with an outside load of at least 3 Nm.
7. After installing the actuator to the damper/armature an automatic alignment has to be accomplished, in order to obtain a „gentle blockade/stop“. This function protects the damper/armature by reducing the end positions/blockade speed in order to avoid mechanical overload. The actuator alignes specifically once with 30 Sec/90° onto each position, recognizes the blockade position in order to reduce the motor performance

during operation briefly before reaching the end /blockade position.

II. 3-pos operation

InMax actuators are in the best way suitable for the 3-pos operation. To protect such elements as gears and mounting elements against harmful influences like minimum pulse time, InMax actuators are protected via internal electronics. The internal electronic permits 20 impulses with < 0.5 > sec. cyclic duration, afterwards at least 1 impulse > 1 sec. must follow. If clocked with more than 20 impulses each < 1 sec. the actuator will adjust into a suspend mode. There after a reset is mandatory and will be achieved by briefly switching of the supply voltage for about 2 sec.. The controll unit has to be parameterized in order to be set within the above mentioned duration limits.

III. Use at low ambient temperature below -20°C

All InMax actuators are equipped with a regulated integrated heating device designed for employments down to -40°C ambient temperature.

The heater will be supplied automatically by connecting the constant voltage supply on the clamps 1 and 2.

Following parameters are to be considered by ambient temperature < 10°C:

1. After mounting the actuator must be immediately electrically connected.
2. The actuator will only be activated after the operating temperature has reached at least -20°C .
3. The adjustment options are only ensured after this heating up period.

Error indication

Error/Symptom	Reason	Solution
01 Actuator does not work LED does not lights	<ul style="list-style-type: none"> No power supply attached The actuator is operated beyond ex-prevention ambient temperature specifications and the internal temperature sensor did irreversibly shut down operations 	<ul style="list-style-type: none"> Attache power supply and turn on Because of inadmissible operation the actuator drove out of safety relevant reasons into an irreversible condition and must be exchanged. Accompanying new installation the ambient temperature has to be reduced accordingly
02 Actuator does not work LED lights red	<ul style="list-style-type: none"> The actuator is operated by a too high ambient temperature and the internal temperature sensor responded 	<ul style="list-style-type: none"> Shut off actuator and let temperature decrease, reduce ambient temperature by suitable measures e.g. ventilation or other mounting position of the actuator
03 Actuator does not work LED lights green	<ul style="list-style-type: none"> 3-Pos control signal is wired on both entrances Required torque is greater than actuators torque Control signals are not attached or attached on a wrong conductor Actuator is incorrect mounted and is blocked by an external stop unit Actuator is clogged with more than 20 impulses <0,5 per sec. and therefore adjusted into suspend mode Interchanged supply lines 	<ul style="list-style-type: none"> Readjust/correct circuit Adjust a higher torque at the actuator if possible otherwise exchange for a type with higher torque. Examine rule and adjusting signal in accordance with attached diagram Dismount actuator and testdrive without load for operability. Install actuator accordingly that the power transmissions runs without external blockade or torsion Switch off supply voltage for at least 2 sec. thereby a reset is conducted Readjust controller in order to extend control pulses Wire 1 must be (-, N) and wire 2 (+, L)
04 Actuator does not work LED is red blinking	<ul style="list-style-type: none"> The actuator has been mounted by temperatures of less than -20°C and did not reach its operating temperature of at least -20°C. 	<ul style="list-style-type: none"> Ensure that a constant voltage supply on conductor 1--2 is existing. Wait until the required operating temperature is achieved by the actuators internal heating system. The actuator will start operating independently
05 Spring return funktion is 10 sec./90°, should however amount to 3 sec./90°	<ul style="list-style-type: none"> Bridge 2 --5 is not established 	<ul style="list-style-type: none"> Bridge conductor 2 of the constant voltage supply with conductor 5
06 Spring return funktion is 3 sec./90°, should however amount to 10 sec./90°	<ul style="list-style-type: none"> Bridge 2 --5 is established 	<ul style="list-style-type: none"> Disconnect bridge
07 Actuator does not start after more than 2 briefly following adjusting functions in the 3 sec. mode where set	<ul style="list-style-type: none"> The maximal permissible cyclic duration of 10% ED was not complied to, the actuator is in a safety disconnection mode 	<ul style="list-style-type: none"> Wait approx. 1 minute until internal electronics cool down to operating temperature.
08 Y-drive in the 3-pos mode can not gear into intermediate positions	<ul style="list-style-type: none"> The conversion of constant mode on 3-pos-modus was not set 	<ul style="list-style-type: none"> Recalibrate the actuator in accordance with assembly instructions
09 Actuator sits diagonally on the squared damper shaft	<ul style="list-style-type: none"> The actuators have an angle of rotation of 95° inclusive 5° pre-tention. While assembling the pre-loading was not considered 	<ul style="list-style-type: none"> Dismount actuator of the damper, use the enclosed socket wrench to draw up approx. 5° over the hand operated control device before remounting on the damper shaft. Consider additional information ME of the assembly instructions
10 Actuator is with clamp stand KBS actuated installed onto damper shaft and does only partly or not at all drive	<ul style="list-style-type: none"> Provided that the electrical basic conditions specified above are fulfilled, the anti-twist plate could be so installed that the actuator blocks itself due to the twisted and not centric shaft connection and therefore interlocks 	<ul style="list-style-type: none"> Loosen the anti-twist plate and remount that the actuator can implement an easy oscillation motion over its angle of rotation
11 A modulating actuator (Y) works with reduced angle of rotation and already reaches its end positions before 0 V/4 mA, respectively before 10V/20mA.	<ul style="list-style-type: none"> At start up no self adjustment of angle of rotation was accomplished 	<ul style="list-style-type: none"> Accomplish self adjustment of angle of rotation in accordance with assembly instruction
12 LED flashes irregularly and actuator does not work	<ul style="list-style-type: none"> Actuator does not receive sufficient supply voltage Cable too long, voltage drop in the supply line to large 	<ul style="list-style-type: none"> Increase line cross section or increase tension at the transformer/power supply unit Increase line cross section or increase tension

InMax - extra information ME



The "ME"-data sheet contains additional information for InMax actuators of the size "S", for the optimization and simplification in regard to planning, installation and initial start up. It provides influences of external factors in reference to the safe initiation of the actuators. In particular it represents the installation, as well as different dampers, fire protection dampers and armatures. Additionally describing different accessory elements and their mounting to the actuator.


- ▶ Dimension, drill template
- ▶ Control elements: switch - push button - LED
- ▶ Outdoor installation
- ▶ Mounting using form-fitting shaft connection (square shaft)
- ▶ Mounting using clamp mounting (round shaft)
- ▶ Mounting on butterfly valves and ball valves
- ▶ Mounting InSwitch

For additional electrical data have a look at "extra information EL"

Dimensions - drill template

Dimension size S

Dimension in mm

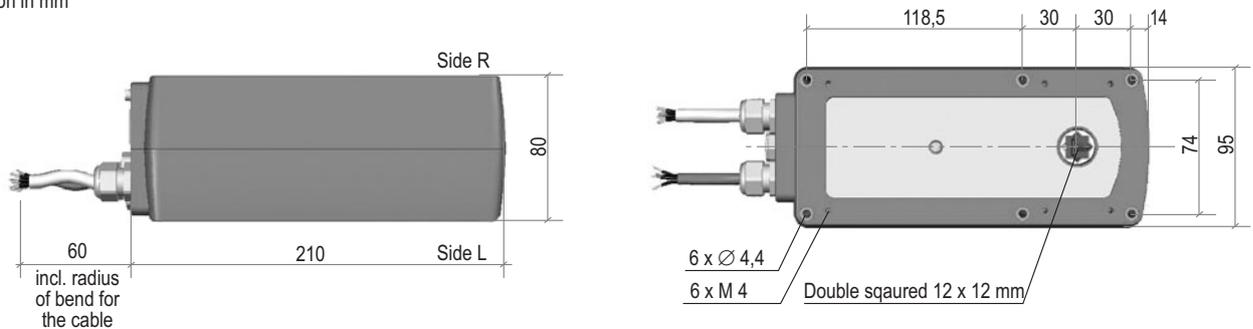


Control elements: switch - push button - LED

Specification

All InMax actuators are equipped with a 10 position switch a push button and a multicolor LED for calibration. These control elements are to be found cable-laterally behind the two middle sectioned dummy plugs. For operation these must be removed. The calibration can be achieved despite lining up tension at the actuator. It has to be of great concern that the dummy plugs must be rescrewed in order to comply with the IP-protection class. The operation of the switch and button has to be done by means of a small screwdriver. Force with strong pressure and /or rotation is to be avoided in any case, since otherwise control electronics can be damaged irreparably. By bad visibilities a flashlight should be used. Attitudes of torque and running time can be achieved also before mounting. The adjustment of angle of rotation can be started only with an outside load and accurate mounting.


Switch - push button - LED for programming, behind dummy plug

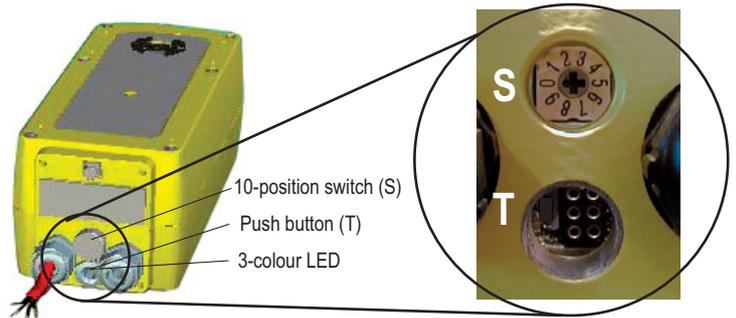

Outdoor installation

Specification

When mounting actuator outdoors it has to be certain that the actuator is protected against direct sun exposure (heat and UV), rain and snow by employing an enclosure roof. Supply voltage is to be applied immediately after mounting in order to assure integrated heating at start. Since explosion proof actuators must have internal safety temperature limiters, these may not be exposed neither at storage nor during operation to a too high temperature. Otherwise the limiters could respond and switch of the actuator irreversibly.

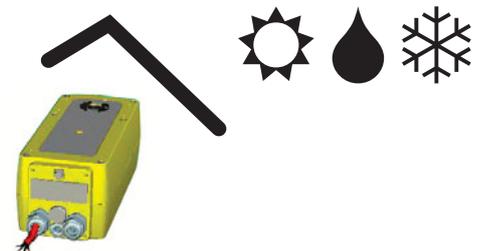

Mounting instruction for InMax actuators size S on air dampers

Specification

InMax actuators size S are equipped with a 12 x 12 mm (double square) shaft connection. The form-fitting shaft connection is the securest connection between damper shaft and actuator because slipping or slipping through is avoided compared to the force-fit clamp-connection. The actuator will be connected firmly by means of four screws M 4 x 100 (scope of supply) to the damper. For the connection to round damper shaft or square damper shaft with smaller or larger 12x12 mm an optional mounting clamp (type KB-S) for tensionally locked connections is available.

Form fitting mounting on square damper shaft

Dimension damper shaft

Length A
Dimension A in acc. with indicator

1. Actuator without indicator A = no limit
2. Actuator with indicator, no accessories A < 65 mm

12 x 12 mm

M4 x 100

4 screws M4 x 100, as well as a socket wrench, are part of delivery for ExMax/RedMax actuators size "S".
For damper shafts 9 x 9, 10 x 10 or 11 x 11 mm reducing bush are optional available.

Mounting clamp type KB-S

Dimension squared damper shaft

Length A < 25 mm

Dimension round damper shaft

Length A < 25 mm

1. Pre-assembly clamp
2. Fixing the clamp
3. Pre-assembling mounting bracket
4. Mounting to the damper

Mounting instructions form-fitting shaft connection

It is to be considered that the actuators have a total angle movement of approx. 95° in order to realize a pre-tension on the damper. Therefore the actuator sits tilted on the damper shaft. In order to prevent this and to assure pre-tension to the damper the driving shaft has to be adjusted mechanically before connecting to the damper shaft. The provided socket wrench serves for the mechanical adjustment over the hand-operated control socket HV. The actuators are axially symmetrically developed. In case of spring return function the safety position must be selected by turning the actuator 180°.

Mounting:

1. Affix tap hole M4 (in accordance with drill template) on the damper or to a mounting bracket.
2. Adjust drive shaft of the actuator with the socket wrench that the drive stands perpendicular to the damper before plugging actuator on to the damper shaft.
3. Plug actuator onto damper shaft and fix diagonally with 2 screws.
4. Remove the socket wrench.
5. Pivot and tighten the remaining screws.

Note: the drive shaft is selflockingly produced and may only be mechanically adjusted either with the provided socket wrench or the optional accessory "HV-S" manual override. External applied force to the shaft can lead to mechanical damage of the actuator.

Mounting instructions for mounting clamp

The actuators are axially symmetrically developed. In case of a spring return function the safety position must be selected by turning the actuator 180°.

Mounting

1. Insert u-bolt connection into drive-shaft and screw the bolt from the opposite side tight with the socket wrench.
2. Screw in two screws functioning as an anti twist locking device.
3. Install mounting bracket at the damper.
4. Plug the actuator to the damper shaft, adjust the actuator in the mounting brackets position and tighten the damper shaft with a socket wrench via the u-bolt connection.

Attention!


The actuator must be installed in such a way that it can implement an easy oscillating motion in the mounting bracket for the reconciliation of the not centric connection.

Note: the drive shaft is selflockingly produced and may only be mechanically adjusted either with the provided socket wrench or the optional accessory "HV-S" manual override. External applied force to the shaft can lead to mechanical damage of the actuator.

Mounting instructions for InMax actuators size S on butterfly valve and ball valve

Specification

InMax actuators of the size S are equipped with a 12x12 mm (double square) form-fitting shaft connection. For mounting to butterfly valves or ball valve a special mounting bracket in acc. with DIN EN ISIO 5211 is required. Since this standard provides only certain basic conditions there can be substantial geometrical differences between armatures which require a special adaption.

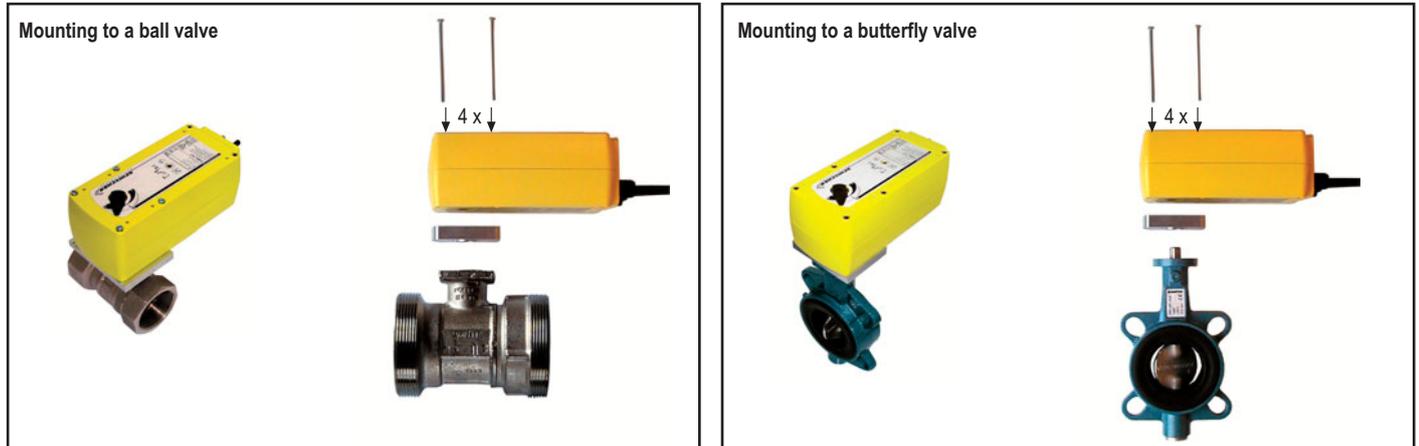

Mounting of InSwitch accessory to the actuator

Specification

1. Put the squared connection part to the actuator, then mount InSwitch and fix it with 4 screws
2. InMax with mounted InSwitch





Mounting of terminal boxes type InBox via mounting bracket MKK-S to the actuator (accessory)

Specification

1. Screw mounting bracket MKK-S to the actuator (A) then terminal box to the mounting bracket (B) schrauben

Mounting bracket MKK-S can be mounted every 90°

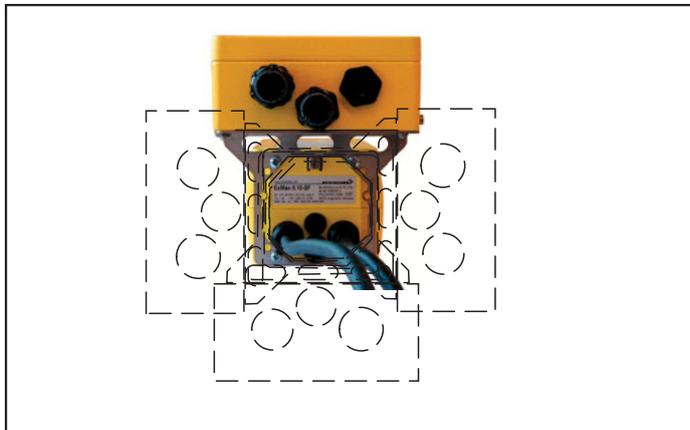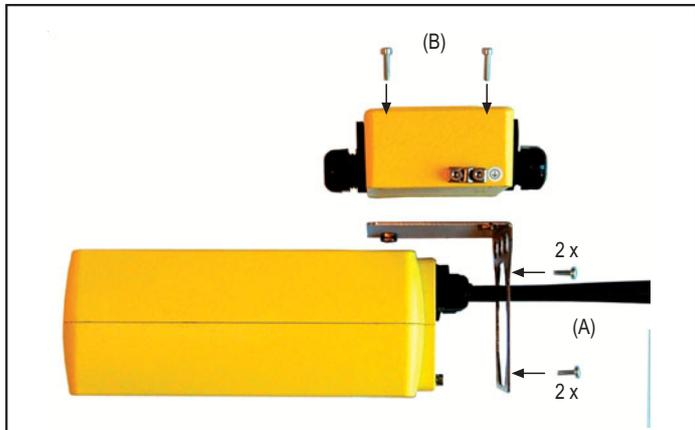

Terminal box mounted above the actuator

Terminal box mounted beside the actuator

