



RedMax - Revolution

Electrical, explosion proof rotary actuators - size M

3-pos, 0...10 VDC, 4...20 mA, 24..230 VAC/DC, 95° Angle of rotation incl. 5° pretention 50/75 Nm - 100 Nm without and 30 Nm - 50 Nm with safety operation (spring return) PTB-tested in acc. with ATEX RL 94/9/EG for zone 2 and 22.

RedMax- 50.75 - Y
RedMax-100 - Y
RedMax- 30 - YF
RedMax- 50 - YF
RedMax- ... - VA
RedMax- ... - CT

Subject to change

Compact - Easy installation - Universal - Cost effective - Safe

Туре	Torque	Supply	Motor running time	Spring return	Control mode	Feedback	Wiring diagram
RedMax-50.75 - Y	50 Nm & 75 Nm	24230VAC/DC	40/60/90/120/150 sec.at 90°	without	3-pos, 010VDC, 420 mA	010VDC, 420 mA	SB 4.0
RedMax- 100 - Y	100 Nm	24230VAC/DC	40/60/90/120/150 sec.at 90°	without	3-pos, 010VDC, 420 mA	010VDC, 420 mA	SB 4.0
RedMax- 30 - YF	30 Nm	24230VAC/DC	40/60/90/120/150 sec.at 90°	20 sec. at 90°	3-pos, 010VDC, 420 mA	010VDC, 420 mA	SB 4.0
RedMax- 50 - YF	50 Nm	24230VAC/DC	40/60/90/120/150 sec.at 90°	20 sec. at 90°	3-pos, 010VDC, 420 mA	010VDC, 420 mA	SB 4.0
RedMax VA	dMax VA Type as above but with stainless steel housing (A316) for aggressive ambients (combination of RedMaxS and -VA is possible)						
RedMax CT	- CT Type as above but with AI - housing and amercoat paint, gearbox parts, cable gland and hollow rivet nickel-plated						

Application

Damper








Throttle valve







Description size M

The new RedMax actuators are a revolution for safety, control and shutoff dampers, VAV systems, ball valves, throttle valves and other motorized applications for HVAC systems, in chemical, pharmaceutical, industrial and Offshore-/Onshore plants, for use in EEx-areas zone 2 (gas) and zone 22 (dust).

Highest protection class (ATEX) and IP 65 protection, small dimensions, only 9,5 kg weight, universal functions and technical data, an integrated heater and an optional stainless steel housing guarantee safe operation even under difficult environmental conditions. High quality brushless motors guarantee long life.

All actuators are programmable and adjustable on site. Special tools or equipment are not required. Motor running times and torques - according to the actuator type - selectable or adjustable on site. The integrated universal power supply is self adaptable to input voltages in the range of 24 to 230 VAC / DC.

The actuators are 100% overload protected and self locking. $\textbf{RedMax-..-F} \ \text{actuators are equipped with spring return fail safe function}$ $\textbf{Standard shaft connection is a double squared direct coupling with } 16 \ x \ 16 \ mm.$

Different accessories are available to adapt aux. switches, terminal boxes or adaptations for ball valves and throttle valves.

Highlights

- For all type of gas, mixtures, vapours and dust for use in zone 2 and 22
- ► Universal supply unit from 24 to 230 V AC/DC
- ▶ 5 different motor running times (40-60-90-120-150 sec./90°), adjustable on site
- ► spring return running time (20 sec./90°)
- ▶ 3-pos, 0...10 VDC, 4...20 mA control mode, with or without spring return function
- ► Feedback signal 0...10 VDC and 4...20 mA
- Reverse function
- ▶ 30 50 75 100 Nm actuators in the same size (M)
- ▶ 100 % overload protected
- Compact design and small dimension (I x w x h = $286 \times 150 \times 116 \text{ mm}$)
- ▶ Direct coupling to the damper shaft with double-squared connection 16 x 16 mm
- ▶ 95° Angle of rotation incl. 5° pre-tention
- ► Robust aluminium housing (optional stainless steel or amercoat painting)
- ▶ IP 65 protection
- ► Simple manual override include + preparation for comfortable manual override
- ► Gear made of stainless steel and sinter metal
- ► Only 9,5 Kg weight
- ▶ Integral heater for ambient temperatures down to -40°C
- Integral safety temperature sensor
- ► Integral equipment for manual adjustment (push button, lamp, switch)
- Preparation for adaptable aux. switches type RedSwitch
- ► Range of accessories



RedMax-50.70-Y RedMax-100-Y RedMax-30-YF

RedMax-50-YF



Special makes RedMax-..-VA/-CT

Technical data	RedMax-50.75-Y	RedMax-100-Y	RedMax-30-YF	RedMax-50-YF		
Torque motor	50 / 75 Nm selectable on site	100 Nm	30 Nm	50 Nm		
Torque spring return (F)	without F	without F	min. 30 Nm	min. 50 Nm		
Dimension of external torque	above mentioned torques are min.	torques in blocked position, extern	al torque should be max. 80 % of max. a	ctuator torque but min. 10 Nm		
Supply voltage/Frequency	24230 VAC/DC, + 15 % / - 20%	, self adaptable, Frequency 50	60 Hz +/- 20 %			
Dimension			> I rated), max. 20 W blocking position, ap	prox. 16 W for heater		
Protection class	class I (grounded)					
Angle of rotation and indication	95°, incl. ~ 5° pre-tention, mechanical value indication					
Working direction	selectable by left/right mounting to	o the damper/valve shaft				
Motor running time	40 / 60 / 90 / 120 / 150 sec. at 90	° selectable on site				
Motor	brushless DC Motor					
Spring return (F)	without F	without F	spring return in the event of lo	ss of power		
Spring return running time (F)	without F	without F	spring return in 20 sec. at 90°			
Safety operations at 20 sec (F)	without F	without F	min. 10.000 in acc. with const	ruction of damper and ambient		
Response time spring return	up to 1 sec. after power failure					
Control mode Y	3-pos, 010 VDC, 420 mA in a	cc. with wiring, selectable on site,	galvanic seperation between supply and	signals		
Feedback signal U	010 VDC, 420 mA in acc. with			•		
Resistance of Y and U signals	Input signal Yu 010 VDC @ 10 kΩ, Yi 420 mA @ 100 Ω. Feedback signal Uu 010 VDC @ 1.000					
Reverse function	Bridge between wiring 3 and 4 (signal wise) gets a reverse function of Y and U					
Adjustment of Y and U	If the angel of rotation is different	to 90° the input Y and output sign	al U can be adjusted to the new angel of	rotation		
Axle of the actuator	double squared 16 x 16 mm, direct coupling, 100 % overload protected and 100 % self locking up to the rated torque					
Electrical connection	cable, ~1 m, diameter of wires 0,5 mm², for connection inside hazardous areas an terminal box is required!					
Diameter of cable	~ Ø 7,1 mm, ~ Ø 7,4 mm					
Cable gland	M16 x 1,5 standard - cable - and wire entries are integral part of explosions proof encapsulation; tested acc. to EN 50018					
Manual override	Manual override only if supply voltage is cut, use delivered socket wrench, slow motion, enough torque/force is required					
	Attention: with manual operation of the spring danger of injury exists, with release/let go the hexagonal spanner!					
Integral heater	integral heater, controlled, for ambient temperature down to - 40°C					
Housing material	Aluminium die cast housing, painted (optional in stainless steel version AISI 316 - type RedMax/VA or amercoat painted /CT)					
Dimensions	I x w x h 286 x 150 x 116 mm, for diagramm see extra information "ME-M".					
Ambients	storage temp 40+ 70°C, working temperature - 40+ 40°C at T6 and - 40+ 50°C at T5, humidity in acc. with EN 60335-1					
Weight	~ 9,5 Kg Aluminium housing (stainless steel ~ 15 Kg)					
Operation mode	100 % ED					
Self adjustment	if you select 40 sec. and 60 sec. mode for motor you need to start the self adjustment mode					
Maintenance	maintenance free, maintenance must be complied with regional standards, rules and regulations					
Wiring diagrams (SB)	SB 4.0	SB 4.0	SB 4.0	SB 4.0		
Delivery	1 actuator, 1 m cable, double squ	ared shaft connection 16x16 mm.	4 screws M 8 x 140, 4 nuts M8			
·	socket wrench for simple manual override					
Parameter at delivery	50 Nm, 90 sec./90°	100 Nm, 90 sec./90°	30 Nm, 90 sec./90°	50 Nm, 90 sec./90°		
	,	,	,	,		

Explosion proof	RedMax actuators - size M			
Certification	PTB 04 ATEX 2106			
ATEX	Directive 94/9/EG (ATEX)			
Approval for gas	II3G EEx nC II T6 II3(1)G EEx [ia] IIC gas, mist, vapour,			
	zone 2			
Approval for dust	II3D IP66 T80°C dust, zone 22			
Identification	CE Nr. 0158			
EMC	EMC-directive 89/336/EG			
Low voltage	Low-voltage directive 73/23/EG			
IP-Protection	IP 65			
Potential compensation	external PA-terminal, 4 mm²			

Accessories or special solutions - size M

RedMax-..-VA above listed types in stainless steel version, housing AISI 316.

RedMax-...-CT above listed types in Al box and amercoat painted

RedBox-... Terminal box for zone 2, 22.

MKK-M mounting bracket for terminal boxes type RedBox-... direct on actuator

2 external aux. switches, 2 x EPU, adjustable, for zone 2, 22 RedSwitch HV-M comfortable manual override for RedMax actuators size M

Adaptations various adaptations for dampers/valves on request



Special makes

RedMax-..-VA/-CT


Electrical connection

RedMax actuators are equipped with a universal supply unit working at a voltage range from 24 to 230 VAC/DC. The supply unit is self adjustable to the connected voltage! The safety operation of the spring return function works if the supply voltage is cut. For electrical connection inside hazardous areas an terminal box, certificated in acc. with ATEX is required (e.g. RedBox).

Switch - Push button - Lamp for adjustment. behind the blancking plug 10-position switch (S) Push button(T) 3-colour LED

Parameter. Adjustment - Failure indication

Wiring diagram

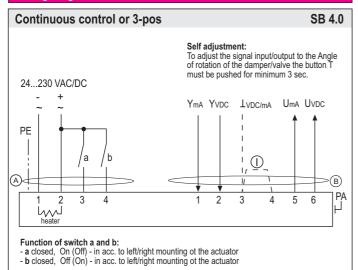



If 40 sec. or 60 sec. mode is selected for motor and/or spring return, the self adjustment of angle of rotation must be started. Never use actuators in this mode without external torque/force.

Parameter selection Example: RedMax-50.75-Y RedMax- 50.75-Y 50 Nm 75 Nm Requested parameter: RedMax-100 -Y 100 Nm RedMax- 30 -YF 30 Nm Torque 75 Nm RedMax- 50 -YF 50 Nm Running time motor 90 sec/90° nnina times on of switch S 05 40 sec./90° Result: switch position (S) 07 06 90 sec./90° 120 sec./90° 07 0.3 08

150 sec./90°

09

Function, adjustment and parameter

A) Self adjustment of Angle of rotation:

Switch (S) into position 02 (low torque) or 07 (high torque), then push button (T) for minimum 3 seconds. The actuator will drive into both end positions to be adjusted. LED indicates green.

Adjusmtent time needs approx. 60 sec. (30 sec. On, 30 sec. Off). After that, switch S into position 00-09 in acc. with your required torque and running time.

B) Selection of running time and torque:

Put switch (S) into the correct/selected position in acc. to above table.

The selected parameter will work at next operation of the actuator.

Adjustment can be done even without supply voltage. If supply voltage is available turn switch only if actuator is not running.

C) Change from modulating into 3-pos operation mode:

Push button (T) 3 times. LED changes from green to yellow.

Push button within next limits:

- Push time min. 0.2 sec.
- The max. time for 3 push is 5 sec.

D) Change from modulating into 3-pos operation mode:

Push button (T) 3 times. LED changes from yellow to green.

E) Additional information for 3-pos operation:

a closed, b open = direction I

b closed, a open = direction II

a and b closed = Motor doesn't work

a and b opened = Motor doesn't work

Direction (I and II) depends on left/right mounting of the actuator to the damper/valve. You can change direction of the motor by changing electrical wiring terminal 3 and 4.

Bridge between wiring 3 and 4 (signal wise) gets a reverse function of Y and U.

Operation and failure indication by LED

LED

GREEN Supply available, Actuator active in modulating mode YELLOW Supply available, Actuator active in 3-pos mode

Error indication

See extra information "EL-M"



Special makes

RedMax-..-VA/-CT

Mounting instructions and important information for operation and installation

Important information for installation and operation

A. Installation, commissioning, maintenance

The cable of the actuator must be installed in a fixed position and protected against mechanical and thermical damage. In acc. with operation RedMax actuators are maintenance free. Nevertheless maintenace must comply with regional standards, rules and regulations. The actuators must not be opened by the customer. For outdoor installation a protective housing against rain, snow and sun should be applied to the actuator, as well as a constant supply at terminal 1 and 2 for the integral heater. For electrical connection inside hazardous areas an terminal box is requested (e.g. type

Attention: If the actuator is put out of operation all EEx-rules and regulation must be applied.

B. Shaft connection, selection of running time, heater

RedMax actuators are equipped with a direct coupling double squared shaft connection of 16 x 16 mm. The housing of the actuator is axially symmetrically built to select open/close direction of the spring return function by left/right mounting. In acc. to the actuator type 5 different motor running times can be selscted on site. The integral heater is for ambient temperatures down to -40°C.

C. Minimum load

Minimum load not less than 20% of the rated torque, min.10 Nm

D. 3-pos control mode

See extra information "EL-M".

E. Spring return

Spring return function works if the supply voltage (terminal 1 or 2) is cut. In the event of an electrical interruption, the spring returns to its end position.

F. Operation at an ambient temperature below - 20°C

See extra information "EL-M".

G. Excess temperature

In acc. to the ATEX rules and regulations EEx actuators must be protected against excess temperature. An internal thermostat guarantees the temperature class in the event of failure. If this thermostat is working the actuator must be sent to the factory. RedMax actuators are equipped with an additional temperature sensor to stop the actuator before reaching this max. temperature. In this case the failure must be eliminated immediately on site.

Mounting on air dampers with double squared shaft connection



Details see extra information "ME-M".

Mounting of quarter turn valves



Details see extra information "ME-M".

RedSwitch - adaptable external switches



RedSwitch is an accessory to RedMax actuators size S, fixing directly onto the actuator. RedSwitch are aux. switches with with 2 potential free contacts, adustable on site. The electrical wiring needs an terminal box.

RedBox - adaptable terminal box



For electrical connection of an RedMax inside the hazardous area an terminal box is required.

RedBox-3P for RedMax-50.75,..-100,..-30-F,..-50-F $\textbf{RedBox-Y/S} \ \text{for RedMax-...-S integral aux. switches}$ To adapt the RedBox direct to the actuator housing an additional accessory type MKK-M is required.

Extra information "EL-M" (see additional data sheet)

extra technical information, versions of circuit diagrams and failure indication

Extra information "ME-M" (see additional data sheet)

extra technical information, dimensions, installation instruction and illustration



ExMax/RedMax - extra information EL-M



The "EL"-data sheet contains additional information for ExMax and RedMax actuators of the size "M", for the optimization and simplification in regard to planning, installation and initial startup. It provides influences of external factors in reference to the safe initiation of the actuators, as well as technical references and problem solutions (error indication). With the error indication, functions can be examined and different error/problems can be adjusted locally.

- ▶ Power supply design
- ▶ Design of line cross section 24...48 VAC/DC
- ▶ Wiring alternatives for on-off, 3-pos, BF actuators
- ▶ Wiring alternatives for modulating actuators
- ► Use at ambient temperatures down to -20°C / 40°C ()
- ► Error indication problem treatment/solution

For additional mechanical data have a look at "extra information ME-M"

Power input depending of supply voltage

Power supply design

The design of the on-site supply, depends on the selected motor running time and selected supply voltage. Accompanying values are "about values", since there can be construction unit dispersions within electronics. The power consumption in the blocking position is run time independently with max. 20 W. The power consumption for the heater is betwen 5 and 12 W. The heading is running only if the motor is in idle position! The initial starting supply voltage required by the actuators power supply unit is around 2,0 A for about 1 Sec. (Please consider this while concepting the cross section of the supply line)

					•	
Voltage	Current	40s	60s	90s	120s	150s
230 V	Irated	0,3 A	0,3 A	0,15 A	0,10 A	0,10 A
24 V	Irated	1,0 A	0,7 A	0,5 A	0,4 A	0,4 A
		Rated current in acc. with motor running time (Spring return)				
Voltage	Current	40s	60s	90s	120s	150s
230 V	Irated	0,4 A	0,3 A	0,15 A	0,10 A	0,10 A
24 V	Irated	2.0 A	1.8 A	1,4 A	1.4 A	1.4 A

Rated current in acc. with motor running time

Dimensioning of the line cross section with 2448 VAC/DC supply voltages

Dimensioning/Design of the supply line


On long distances between voltage supply and drive, voltage drops occur due to line resistances. As a consequence with 24 VAC/DC the actuator receives a too low tension and does not start. In order to prevent this, the cross section of the inlet line is to be designed/dimensioned accordingly. The accompanying formula allows the calculation of the necessary line cross section, perhabs provides the maximally permitted conduit length utilizing the existing line cross section. Alternatively the secondary voltage can be increased by selecting a transformer. For calcualtion purposses, following characteristics are essential: UV = supply voltage in [V]


A = line cross section in [mm²]

L = conduit length in [m]

Factor 0.0714 = drive-specific factor

[Vmm²/m] (based on the electrical conductivity of electrolytic copper with a coefficient of 56m/Wmm²)

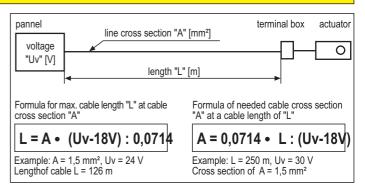

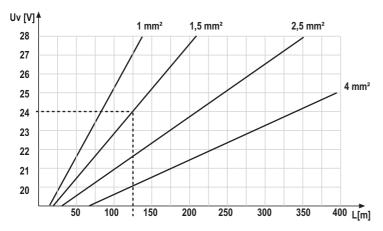


Example:


24 V power supply with wire diameter 1,5 mm² = 126 m



Wiring alternatives for on-off and 3-pos actuators with spring return

ExMax-...-F, ExMax-...-SF, RedMax-...-F, RedMax-...-SF






V Attention! **V**


If 40 sec. or 60 sec. mode is selected for motor and/or spring return, the self adjustment of angle of rotation must be started.


Never use actuators without external torque/force min. 10 Nm.


Wiring alternatives for BF actuators

ExMax-...-BF, RedMax-...-BF

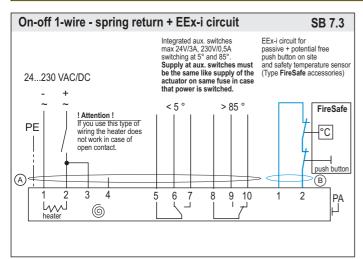

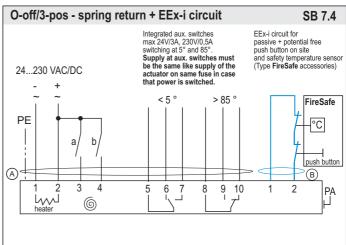

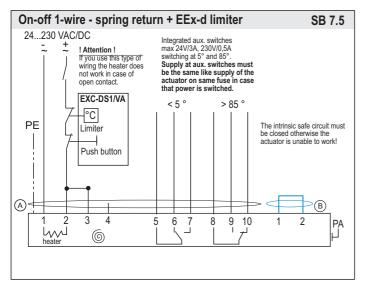






motor and/or spring return, the self adjustment of angle of rotation must be started.


Never use actuators without external torque/force min. 10 Nm.





Wiring alternatives for modulating actuators with or without spring return

ExMax-...-Y.., RedMax-...-Y..

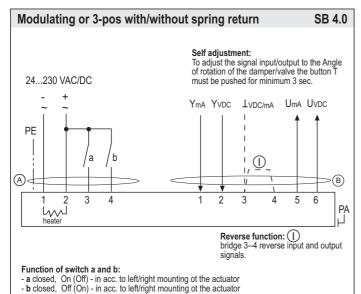

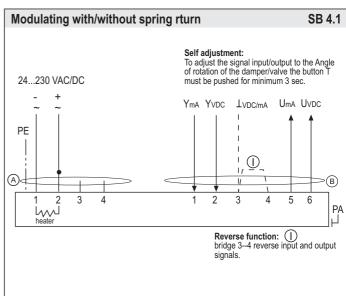

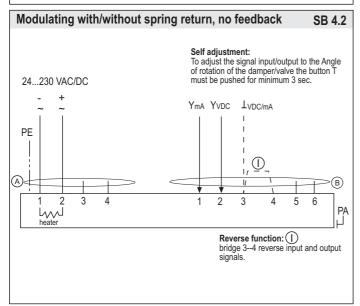

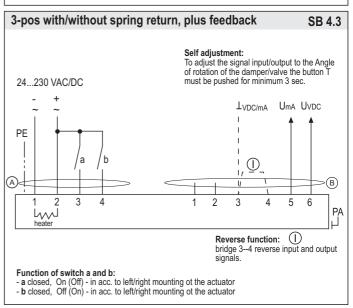

Over temperature, 3-pos-operation, heating by low ambient temperatures

I. Temperature rise

While operating the ExMax actuator following parameters have to be aligned: At overload resp. temperature rise the actuator will remain functionless until cooling During cooing the LED is red.

II. 3-pos operation

ExMax (RedMax) actuators are in the best way suitable for the 3-pos operation. To protect such elements as gears and mounting elements against harmful influences like minimum pulse time, ExMax (RedMax) actuators are protectet via internal electronics. The internal electronic permits 20 impulses with < 0.5 > sec. cyclic duration, afterwards at least 1 impulse > 1 sec. must follow. If clocked with more than 20 impulses each < 1 sec. the actuator will adjust into a suspend mode. There after a reset is mandadory and will be achieved by briefly switching of the supply voltage for about 2 sec.. The controll unit has to be parameterized in order to be set within the above mentioned duration limits.

III. Use at low ambient temparature below - 20°C

All ExMax (Redmax) actuators are equipped with a regulated integrated heating device designed for employments down to -40°C ambient temperature.

The heater will be supplied automatically by connecting the constant voltage supply on the clamps 1 and 2.

Following parameters are to be considered by ambient temperaure < 10°C:

- 1. After mounting the actuator must bei immediately electrically connected.
- 2. The actuator will only be activated after the operating temperature has reached at least $-20\,^{\circ}\text{C}$.
- 3. The adjustment options are only ensured after this heating up period.

IV. Mechanical protection

- 1. The actuator must be operated with an outside load of at least 10 Nm.
- 2. After installing the actuator to the damper/armature an automatic alignment has to be accomplished, in order to obtain a "gentle blockade/stop". This function protects the damper/armature by reducing the end positions/blockade speed in order to avoid mechanical overload. The actuator alignes specifically once with 90 Sec/90° onto each position, recognizes the blockade position in order to reduce the motor performance during operation briefly before reaching the end /blockade position.



Error indication

	Error/Symptom	Reason	Solution
01	Actuator does not work LED does not lights	 No power supply attached The actuator is operated beyond ex-prevention 	 Attache power supply and turn on Because of inadmissable operation the actuator drove out of safety
		ambient temperature specifications and the internal temperature sensor did irreversibly shut down operations	relevant reasons into an irreversible condition and must be exchanged. Accompanying new installation the ambient temperature has to be reduced accordingly
02	Actuator does not work LED ligths red	 The actuator is operated by a too high ambient temperature and the internal temperature sensor responded 	 Shut off actuator and let temperature decrease, reduce ambient temperature by suitable measures e.g. ventilation or other mounting position of the actuator
03	Actuator does not work	3-Pos control signal is wired on both entrances	Readjust/correct circuit
	LED lights green	Required torque is greater than actuators torque	 Adjust a higher torque at the actuator if possible otherwise exchange for a type with higher torque.
		Control signals are not attached or attached on a wrong conductor	Examine rule and adjusting signal in accordance with attached diagram
		 Actuator is incorrect mounted and is blocked by an external stop unit 	 Dismount actuator and testdrive without load for operability. Install actuator accordingly that the power transmissions runs without external blockade or torsion
		 Actuator is clocked with more than 20 impulses <0,5 per sec. and therefore adjusted into suspend mode 	 Switch off supply voltage for at least 2 sec. thereby a reset is conducted Readjust controller in order to extend control pulses
		 Interchanged supply lines 	Wire 1 must be (-, N) and wire 2 (+, L)
04	Acuator does not work LED is red blinking	 The actuator has been mounted by temperatures of less than -20°C and did not reach is operating temperatur of at least -20°C. 	 Ensure that a constant voltage supply on conductor 12 is existing. Wait until the required operating temperature is achieved by the actuators internal heating system. The actuator will start operating independently
05	Y-drive in the 3-pos mode can not gear into intermediate positions	The conversion of constant mode on 3-pos-modus was not set	Recalibrate the actuator in accordance with assembly instructions
06	Actuator sits diagonally on the squared damper shaft	 The actuators have an angle of rotation of 95° inclusive 5° pre-tention. While assembling the pre- loading was not considered 	Dismount actuator of the damper, use the enclosed socket wrench to draw up approx. 5° over the hand operated control device before remounting on the damper shaft. Consider additional information ME-M of the assembly instructions
07	A modulating actuator (Y) works with reduced angle of rotation and already reaches its end positions before 0 V/4 mA, respectively before 10V/20mA.	At start up no self adjustment of angle of rotation was accomplished	Accomplish self adjustment of angle of rotation in accordance with assembly instruction
08	LED flashes irregularly and actuator does not work	Actuator does not receive sufficient supply voltage	Increase line cross section or increase tension at the transformer/power suply unit
		 Cable to long, voltage drop in the supply line to large 	 Increase line cross section or increase tension





ExMax/RedMax - extra information ME-M



The "ME-M"-data sheet contains additional information for ExMax and RedMax actuators of the size "M", for the optimization and simplification in regard to planning, installation and initial start up.-It shows influences of external factors in reference to the safe operation of the actuators. In particular it represents the installation, as well as different kind of dampers, fire dampers and armatures. Additionally describing different accessories and their mounting to the actuator.


- ► Dimension, drill template
- ► Control elements: switch push button LED
- Outdoor installation
- Mounting using form-fitting shaft connection (square shaft)
- Mounting on butterfly valves and ball valves
- ► Mounting on fire dampers
- ► Mounting ExBox (RedBox), ExSwitch (RedSwitch)


For additional electrical data have a look at "extra information EL"

Dimensions - drill template

Dimension size M

Dimension in mm



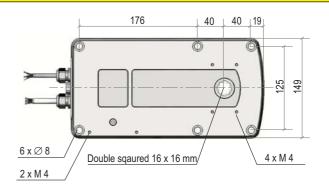


Control elements: switch - push button - LED

Specification

All ExMax and RedMax actuators are equipped with a 10 position switch a push button and a multicolor LED for programming. These control elements are to be found cable-laterally behind the two middle sectioned dummy plugs. For operation these must be removed. The calibration can be achieved despide lining up tension at the actuator. The explosion prevention is not effected. However it has to be of great concern that the dummy plugs must be rescrewed in order to comply with the IP-protection. The operation of the switch and button has to be done by means of a small screwdriver. Force with strong pressure and /or rotation is to be avoided in any case, since otherwise control electronics can be damaged irreparably. By bad visibilities a flashlight (certified within the EX-range) should be used. Attitudes of torque and running time can be achieved also before mounting. The adjustment of angle of rotation can be started only with an outside load and accurate mounting.

Switch - push button - LED for programming, behind dummy plug

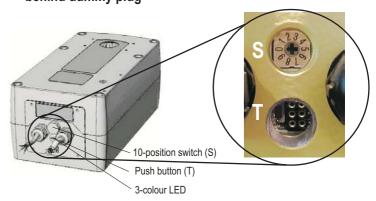

Outdoor installation

Specification

For outdoor installation it has to be certain that the actuator is protected against direct sun exposure (warmth and UV), rain and snow by employing an enclosure roof. Supply voltage is to be applied immediately after mounting in order to assure integrated heating at start. Since explosion proof actuators must have internal safety temperature limiters, these may not be exposed neither at storage nor during operation to a too high temperature. Otherwise the limiters could respond and switch of the actuator irreversibly.








Mounting instruction for ExMax and RedMax actuators size M on air dampers

Specification

ExMax and RedMax actuators size M are equipped with a 16 x 16 mm (double square) shaft connection. The form-fitting shaft connection is the securest connection between damper shaft . The actuator will be connected firmly by means of four screws M 8 x 140 (scope of supply) to the damper.

Form fitting mounting on square damper shaft

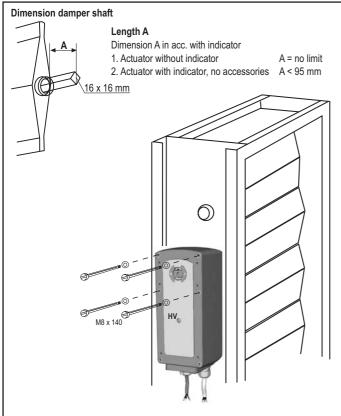

4 screws M8 x 140, as well as a socket wrench, are part of delivery for ExMax/RedMax actuators size "S".

For damper shafts 14 x 14 or 12 x 12 mm reducing bush are optional available.



Mounting instructions form-fitting shaft connection

It is to be considered that the actuators have a total angle movement of approx. 95° in order to realize a pre-tention on the damper. Therefore the actuator sits tilted on the damper shaft. In order to prevent this and to assure pre-tention to the damper the driving shaft has to be adjusted mechanically before connecting to the damper shaft. The provided socket wrench serves for the mechanical adjustment over the hand-operated control socket HV. The actuators are axially symmetrically developed. In case of spring return function the safety postion must be selected by turning the actuator 180° .

Mounting:

- Affix tap hole M8 (in accordance with drill template) on the damper or to a mounting bracket.
- Adjust drive shaft of the actuator with the socket wrench that the drive stands perpendicular to the damper before pluging actuator on to the damper shaft.
- 3. Plug actuator onto damper shaft and fix diagonally with 2 screws.
- 4. Remove the socket wrench.
- 5. Pivot and tighten the remaining screws.

Note: the drive shaft is selflockingly produced and may only be mechanically adjusted either with the provided socket wrench or the optional accessory "HV-M" manual override. External applied force to the shaft can lead to mechanical damage of the actuator.



Mounting instructions for ExMax and RedMax actuators size M on butterfly valve and ball valve

Specification

ExMax and RedMax actuators of the size M are equiped with a 16x16 mm (double square) form-fitting shaft connection. For mounting to butterfly valves or ball valve a special mounting bracket in acc. with DIN EN ISIO 5211 is required. Since this standard provides only certain basic conditions there can be substantial geometrical differences between armatures which require a special adaption.





Mounting instructions for ExMax and RedMax actuators Size M on fire dampers

Specification

ExMax and RedMax actuators of the size M are equipped with a 16x16 mm (double square) form-fitting shaft connection. The form-fitting shaft connection is the securest connection between damper shaft and actuator. The actuator is fixed with four screws directly to the fire damper and/or fixed to a mounting bracket. ExMax-...-BF and RedMax-...-BF actuators integrate an intrinsically safe circuit in order to connect a FireSafe sensor which works like a temperature limiter.

Assembly

It is to be considered that the actuators have a total angle of rotation of approx. 95° in order to realize a pre-tention on the damper. Therefore thr actuator sits tilted on the damper shaft. In order to prevent this and to assure pre-tention to the damper the driving shaft has to be adjusted mechanically before connecting to the damper shaft. The provided socket wrench serves for the mechanical adjustment over the hand-operated control socket HV.The actuators are axially symmetrically developed. In case of a spring return function the safety postion must be selected by turning the actuator 180°.

Mounting:

- Affix tap hole M8 (in accordance with drill drill template) on the damper or to a mounting bracket.
- Adjust drive shaft of the actuator with the socket wrench that the drive stands perpendicular to the damper before pluging actuator on to the damper shaft.
- 3. Plug actuator onto damper shaft and fix diagonally with 2 screws.
- 4. Remove the socket wrench.
- 5. Pivot and tighten the remaining screws.
- 6. Mount temperatur limiter type Fire Safe
- 7. Mount terminal box
- 8. Connect sensor on actuator

Note: the drive shaft is selflockingly produced and may only be mechanically adjusted either with the provided socket wrench or the optional accessory "HV-M" manual override. External applied force to the shaft can lead to mechanical damage of the actuator.







Mounting of terminal boxes type ExBox (RedBox) via mounting bracket type MKK-M to the actuator (accessory)

Specification

1. Screw mounting bracket MKK-S to the actuator (A) then terminal box to the mounting bracket (B) screws

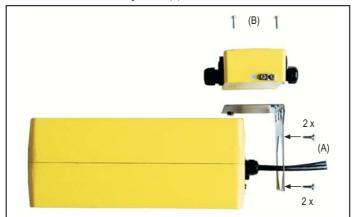

Mounting bracket MKK-M can be mounted every 90°

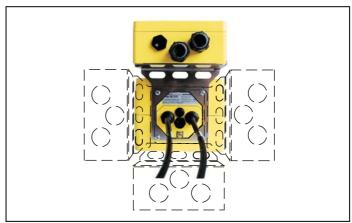

Terminal box mounted above the actuator



Terminal box mounted beside the actuator



Mounting of ExSwitch (RedSwitch) accessory to the actuator

Specification

1. Put the squared connection part to the actuator, then mount ExSwitch(RedSwitch) and 2. ExMax (RedMax) with mounted ExSwitch (RedSwitch) fix it with 4 screws

